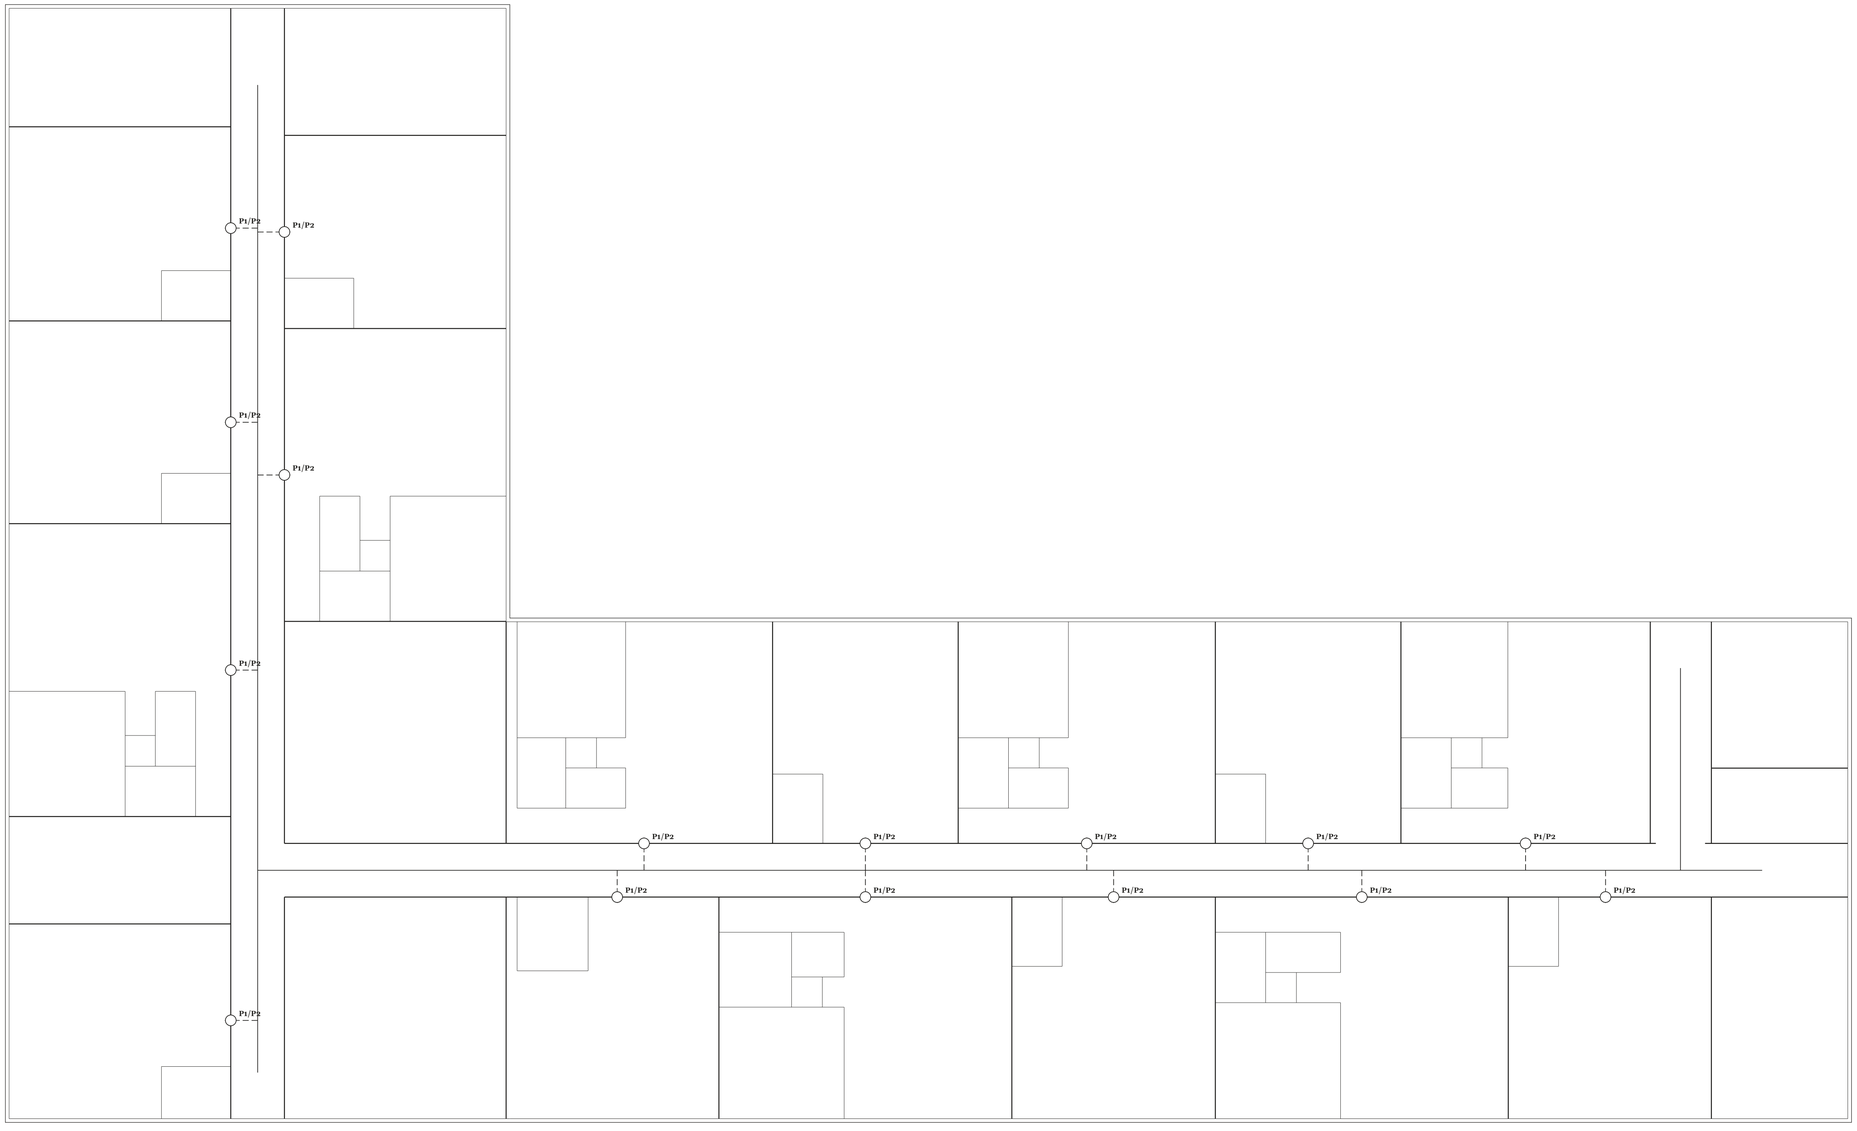


NOTES

1. OSSC 714.4.1.2: EACH THROUGH PENETRATION OF A RATED WALL TAKES A LISTED SYSTEM WHOSE F RATING IS NOT LESS THAN THE WALL'S. TAGS KEY TO THE FIRESTOP SCHEDULE ON G0.20.

2. ARCHITECT: CONFIRM THE RATED WALLS SHOWN HEAVY FROM THE ELEMENT FILE. SOLID RUNS ARE CORRIDOR MAINS, DASHED RUNS ARE BRANCHES INTO THE UNITS: DUCT, SPRINKLER PIPE AND CONDUIT AS THE ROUTER LAYS THEM.

3. MEP ENGINEER: PROVIDE THE PLUMBING DRAINS AND STACKS, FLOOR PENETRATIONS AND SMOKE DAMPERS NOT SHOWN. THE ROUTER STOPS EACH ELECTRICAL BRANCH SHORT OF THE RATED WALLS, SO NO BRANCH CONDUIT CROSSES ONE.

4. 717.5.4 EXCEPTION 1 WAIVES THE FIRE DAMPER WHERE A DUCT PENETRATES A CORRIDOR WALL IN A BUILDING SPRINKLERED UNDER 903.3.1.1 OR 903.3.1.2. THE IBG SAYS SPRINKLERED AND NAMES NO STANDARD, SO THE DAMPER QUESTION STAYS OPEN.

1 PENETRATIONS, L2

SCALE: 1/8" = 1'-0"

0' 5' 10' 15' 20'

N

PLAN NORTH TAKEN AS TRUE NORTH

SHEET NOTES

1. FIRESTOPPING: SPECIFIED IN SECTION 07 84 00.

NOT PROVIDED — BY OTHERS
APPLICANT / OWNER

CONSULTANTS

STRUCTURAL	NOT PROVIDED — BY OTHERS
CIVIL	NOT PROVIDED — BY OTHERS
MECHANICAL	NOT PROVIDED — BY OTHERS
PLUMBING	NOT PROVIDED — BY OTHERS
ELECTRICAL	NOT PROVIDED — BY OTHERS
LANDSCAPE	NOT PROVIDED — BY OTHERS
FIRE PROTECTION	NOT PROVIDED — BY OTHERS
GEOTECHNICAL	NOT PROVIDED — BY OTHERS

REVIEW

Prepared for review by the design professional of record. Not for construction or permit submission.

PROJECT

Architecture.Engineering — L courtyard study

FICTIONAL STUDY: NO REAL PARCEL
ARCHITECTURE.ENGINEERING — L COURTYARD STUDY
OCCUPANCY R-2, M · CONSTRUCTION NOT PROVIDED — BY OTHERS · STORIES 4

REVISIONS

MARK	DATE	DESCRIPTION

REGISTER

Project	AE-STUDY-L01
Issue	NOT PROVIDED — BY OTHERS
Date	NOT PROVIDED — BY OTHERS
Drawn	NOT PROVIDED — BY OTHERS
Scale	1/8"
Phase	CONSTRUCTION DOCUMENTS

OPEN ISSUE

The set's open issue is stated on the cover, G0.01.

PENETRATION PLAN

SHEET

G0.19